ཤེས་རིག་དང་རང་བཞིན་རིན་ཆེན་ལྷན་ཁག། དཔལ་འབྱོར་རྒྱལ་ཁབ། བྷུཊཱན།

Ministry of Energy and Natural Resources
Royal Government of Bhutan
Office of the Bhutan Power System Operator
Thimphu: Bhutan

THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 27-Jul-2025(-ve:import, +ve:export)

Report Details	Date	Time	National Coincidental Peak Load (MW)	Date	Time	Load
	July 26, 2025	9:00 AM		17-Jul-25	19:45:37	1035.63

Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170MW THP	Unit- I	187.97	400kV THP - Siliguri Line - I	235.14	
		Unit- II	188.07	400kV THP - Siliguri Line - II	233.61	
		Unit- III	187.49	400kV THP - Siliguri Line- IV	224.71	
		Unit- IV	187.68	400kV THP - Malbase Line - III	423.54	
		Unit- V	187.29	400kV Malbase - Siliguri Line	177.92	
		Unit- VI	187.61	-	-	
		Total	**1,126.11**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.81%**	
2	4 x 180MW MHP	Unit-I	197.93	400kV MHP - Jigmeling Line - I	282.76	400kV MHP - Jigmeling Line- II on standby.
		Unit-II	197.86	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	191.42	400kV MHP - Jigmeling Line - III	293.79	
		Unit-IV	196.60	400kV MHP - Jigmeling Line - IV	293.86	
		-	-	220kV Jigmeling - BitDeer Line - I	36.09	
		-	-	220kV Jigmeling - BitDeer Line - II	36.84	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	193.82	
		-	-	400kV Jigmeling - Alipurduar Line - I (*direct lines*)	784.73	
		-	-	400kV Jigmeling - Alipurduar Line - II (*direct lines*)	785.46	
		-	-	80MVA, 220/132kV ICT - I (HV)	60.20	
		-	-	80MVA, 220/132kV ICT - II (HV)	59.71	
		-	-	132kV MHP - Yurmo Line - II	54.34	
		-	-	132kV Gelephu - Salakati Line	61.89	
		Total	**783.81**	**Auxiliary Consumption & Transformation Losses at Generator end**	**-1.53%**	
3	6 x 170MW PHP-II	Unit- I	183.99	400kV PHP II - Jigmeling -I (*erstwhile interim lines*)	466.20	400kV PHP II - Alipurduar- I not in Service. 400kV PHP II-Alipurduar-II tripped @ 25.07.25 11:32hrs and under inspection(Protection Setting)
		Unit- II	186.72	400kV PHP II - Jigmeling -II (*erstwhile interim lines*)	465.00	
		Unit- III	188.11	400kV PHP II - Alipurduar -I (*erstwhile interim lines*)	0.00	
		Unit- IV	186.49	400kV PHP II - Alipurduar -II (*erstwhile interim lines*)	0.00	
		Unit- V	186.85	-	-	
		Unit- VI	0.00	-	-	
		Total	**932.16**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.10%**	
4	4 x 84MW CHP	Unit- I	91.40	220kV CHP - Birpara Line - I	47.05	-
		Unit- II	91.24	220kV CHP - Birpara Line - II	46.69	
		Unit- III	91.34	220kV CHP - Gedu	146.40	
		Unit- IV	91.58	220kV CHP - Jamjee **(old)** - I	37.90	
		-	-	220kV CHP - Jamjee - II **(new)**	37.73	
		-	-	220kV CHP - Jamjee - III **(new)**	36.25	
		-	-	220kV Malbase - Birpara Line	6.44	
		-	-	66kV CHP - Gedu Line	11.10	
		-	-	3x3MVA, 66/11kV TFR	1.30	
		Total	**365.56**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.31%**	
5	2 x 12MW BHP (U/S)	Unit- I	9.05	220kV BHP - Semtokha Line	171.93	
		Unit- II	9.38	66kV BHP - Lobeysa Line	24.43	
		Total	**18.43**	220kV BHP - Tsirang Line	-145.42	
6	2 x 20MW BHP (L/S)	Unit- I	16.77	5MVA, 66/11kV TFR	0.43	
		Unit- II	15.59	30MVA ICT, 220/66kV (HV)	7.03	
		Total	**32.36**	**Auxiliary Consumption & Transformation Losses at Generator end**	**-1.14%**	
7	2 x 63MW DHP	Unit-I	63.48	220kV DHP - Tsirang Line	0.00	220kV DHP - TSI Line on Standby.
		Unit-II	63.30	220kV DHP - Dagapela Line	125.99	
		-	-	220kV BitDeer - Dagapela Line	52.03	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	**126.78**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.47%**	
8	4 x 15MW KHP	Unit- I	16.50	132kV KHP - Nangkhor Line	44.02	
		Unit-II	16.57	132kV KHP - Kilikhar Line	19.79	
		Unit- III	15.60	5MVA, 132/11kV TFR	0.29	
		Unit- IV	15.95	132kV Motanga - Rangia Line	-9.95	
		Total	**64.62**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.80%**	
9	2 x 59MW NHP	Unit-I	64.96	132kV NHP-MHP-I	64.46	
		Unit-II	64.94	132kV NHP-MHP-II	64.47	
		Total	**129.90**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.75%**	
10	2 x 9MW SHP	Unit- I	3.00	66kV SHP-Damdhum (Samtse)	0.00	Unit-II on Standby. Interim measure: evacuation is through 33kV system.
		Unit- II	0.00	-	-	
		Total	**3.00**	**Auxiliary Consumption & Transformation Losses at Generator end**	**100.00%**	

Note: Generation-Load Summary (MW) for 26-Jul-25 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,582.73	989.04	2,593.69

Note: Generation-Load Summary (MW) for 26-Jul-24 at 09:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,616.24	870.41	1,745.83

09:00 hrs Statistical Comparison (MW) for this and last year



THE DAILY BHUTAN POWER SYSTEM OPERATOR LOAD-GENERATION BALANCE REPORT & ENERGY FIGURES ISSUED ON 27-Jul-2025(-ve:import, +ve:export)

Report Details	Date	Time	National Coincidental Peak Load (MW)	Date	Time	Load
	July 26, 2025	19:00:00		17-Jul-2025	19:45	1035.63

Sl. No.	Hydropower Plant	Unit	MW	Transmission Lines and Elements	Load (MW)	Remarks
1	6 x 170MW THP	Unit- I	188.05	400kV THP - Siliguri Line - I	224.06	
		Unit- II	188.06	400kV THP - Siliguri Line - II	223.25	
		Unit- III	187.65	400kV THP - Siliguri Line - IV	214.45	
		Unit- IV	187.73	400kV THP - Malbase Line - III	455.64	
		Unit- V	187.20	400kV Malbase - Siliguri Line	157.06	
		Unit- VI	187.62	-	-	
		Total	**1,126.31**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.79%**	
2	4 x 180MW MHP	Unit-I	197.63	400kV MHP - Jigmeling Line - I	275.79	400kV MHP-JLG Line- II on Standby.
		Unit-II	197.53	400kV MHP - Jigmeling Line - II	0.00	
		Unit-III	191.41	400kV MHP - Jigmeling Line - III	286.18	
		Unit-IV	196.64	400kV MHP - Jigmeling Line - IV	286.38	
		-	-	220kV Jigmeling - BitDeer Line - I	37.32	
		-	-	220kV Jigmeling - BitDeer Line - II	37.13	
		-	-	500MVA, 400/220kV ICT at Jigmeling (HV)	200.00	
		-	-	400kV Jigmeling - Alipurduar Line - I (*direct lines*)	687.27	
		-	-	400kV Jigmeling - Alipurduar Line - II (*direct lines*)	685.82	
		-	-	80MVA, 220/132kV ICT - I (HV)	63.16	
		-	-	80MVA, 220/132kV ICT - II (HV)	62.67	
		-	-	132kV MHP - Yurmo Line - II	54.34	
		-	-	132kV Gelephu - Salakati Line	65.17	
		Total	**783.21**	**Auxiliary Consumption & Transformation Losses at Generator end**	**1.21%**	
3	6 x 170MW PHP-II	Unit- I	183.99	400kV PHP II - Jigmeling -I (*erstwhile interim lines*)	744.20	Unit II under shutdown 400kV PHP II-Alipurduar-I not in Service. 400kV PHP II-Alipurduar-II tripped @ 11:32hrs.
		Unit- II	0.00	400kV PHP II - Jigmeling -II (*erstwhile interim lines*)	0.00	
		Unit- III	188.30	400kV PHP II - Alipurduar -I (*erstwhile interim lines*)	0.00	
		Unit- IV	187.28	400kV PHP II - Alipurduar -II (*erstwhile interim lines*)	0.00	
		Unit- V	186.77	-	-	
		Unit- VI	0.00	-	-	
		Total	**746.34**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.29%**	
4	4 x 84MW CHP	Unit- I	91.72	220kV CHP - Birpara Line - I	43.00	
		Unit- II	91.17	220kV CHP - Birpara Line - II	42.41	
		Unit- III	91.49	220kV CHP - Gedu	124.10	
		Unit- IV	91.77	220kV CHP - Jamjee - I	48.57	
		-	-	220kV CHP - Jamjee - II	48.17	
		-	-	220kV CHP - Jamjee - III	46.46	
		-	-	220kV Malbase - Birpara Line	17.80	
		-	-	66kV CHP - Gedu Line	10.73	
		-	-	3x3MVA, 66/11kV TFR	1.37	
		Total	**366.15**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.37%**	
5	2 x 12MW BHP (U/S)	Unit- I	9.53	220kV BHP - Semtokha Line	153.80	
		Unit- II	9.25	66kV BHP - Lobeysa Line	27.52	
		Total	**18.78**	220kV BHP - Tsirang Line	-132.03	
6	2 x 20MW BHP (L/S)	Unit- I	15.36	5MVA, 66/11kV TFR	0.52	
		Unit- II	16.02	30MVA ICT, 220/66kV (HV)	9.84	
		Total	**31.38**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.70%**	
7	2 x 63MW DHP	Unit-I	59.45	220kV DHP - Tsirang Line	0.00	220kV DHP - TSI Line on Standby.
		Unit-II	55.51	220kV DHP - Dagapela Line	114.43	
		-	-	220kV BitDeer - Dagapela Line	48.30	
		-	-	5MVA, 220/33kV TFR	0.20	
		Total	**114.96**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.29%**	
8	4 x 15MW KHP	Unit- I	16.53	132kV KHP - Nangkhor Line	43.24	
		Unit-II	16.52	132kV KHP - Kilikhar Line	22.07	
		Unit- III	16.69	5MVA, 132/11kV TFR	0.35	
		Unit- IV	16.50	132kV Motanga - Rangia Line	-8.45	
		Total	**66.24**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.88%**	
9	2 x 59MW NHP	Unit-I	64.87	132kV NHP-MHP-I	64.46	
		Unit-II	64.97	132kV NHP-MHP-II	64.46	
		Total	**129.84**	**Auxiliary Consumption & Transformation Losses at Generator end**	**0.71%**	
10	2 x 9MW SHP	Unit- I	3.00	66kV SHP-Damdhum (Samtse)	0.00	Unit II on Standby. Interim measure: Evacuation is through 33kV System.
		Unit- II	0.00	-	-	
		Total	**3.00**	**Auxiliary Consumption & Transformation Losses at Generator end**	**100.00%**	

Note: Generation-Load Summary (MW) for 26-Jul-2025 at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	3,386.21	1,034.37	2,351.84

Note: Generation-Load Summary (MW) for 26-Jul-2024, at 19:00 hrs

Sl. No.	Region	Total Generation	Total Domestic Load (Total Generation - Total Export)	Total Export(+ve)/ Import(-ve)
1	Both Eastern & Western (Whole Bhutan)	2,560.88	896.86	1,664.02

Note: Daily Energy (MUs) and Power(MW) Statistics for 26-Jul-2025

Sl. No.	Total Energy Generation	Daily Energy Met	Net Energy Import (IEX and Solar)	Net Energy Export	Peak Cross-border (MW)
1	82.60	23.36	0.00	59.58	2,642.10

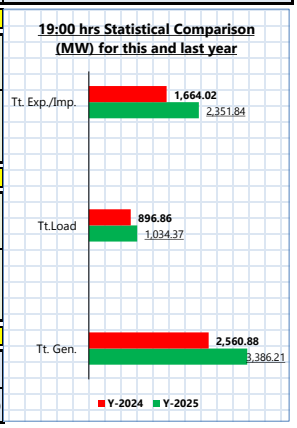

1. The Instantaneous load balance does not tend towards zero. This could be due to the following reasons:

   i) Not all the meters are digital and nor are all the meter at all locations can be read at same time (say 9:00hrs) due to many meter to be read manually. ii) The clocks of all the locations are not synchronized.

2. This report, compiled using the SCADA data, is prepared to give an overall idea of the generation & load flow for the system at a particular instant. This report also gives energy and import/export figures.
3. When SCADA data are unavailable for certain stations due to technical issues, required data are collected from the site.